


NET-ACCESS S-Type Server Cabinets (S2RP, S5RP, S8RP, Adjustable Cage Nut Equipment Rails)

INSTRUCTIONS V00029DP

© Panduit Corp. 2014


Equipment Rail Installation

- Install [4] Equipment Rail Mounting Brackets to Equipment Rails with [3] Counter-sunk Torx screws per bracket (use T25 Torx bit)
- Ensure that counter-sinks of brackets are oriented to match heads of counter-sunk screws

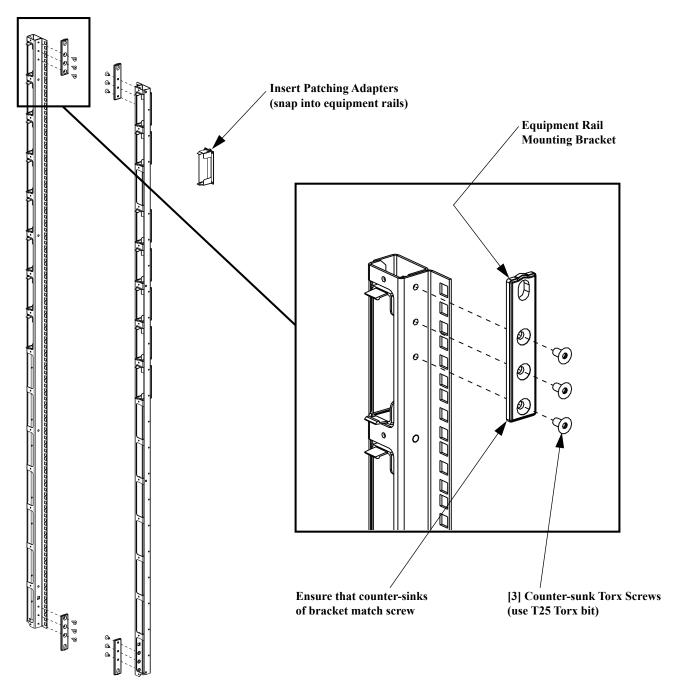

Equipment Rail Installation

- Locate desired Equipment Rail position
- Insert [2] Equipment Rail Mount Nuts through slots of Front-to-Back Beam (top and bottom locations)
- Fasten [2] M10 Hex Screws to E-Rail Mount Nuts at top and bottom of Equipment Rail
- Tighten M10 Hex Head Screw to 30.0 +/- 5.0 N-m [22.1 +/- 3.7 Ft-lbs]

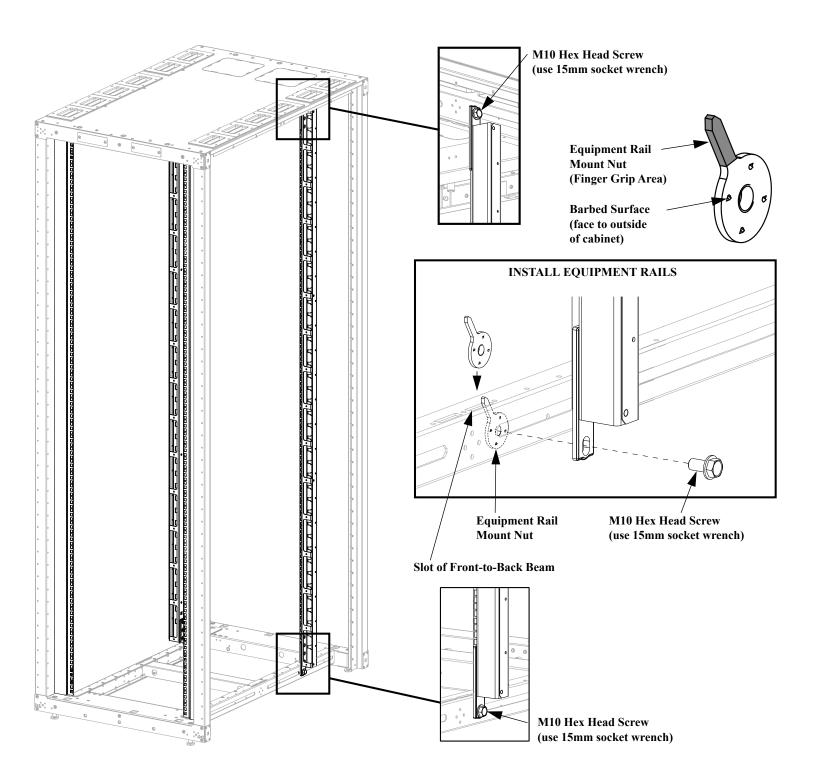

For Instructions in Local Languages and Technical Support:

www.panduit.com/resources/install_maintain.asp



E-mail: techsupport@panduit.com Phone: 866-405-6654